




Impulse




Arendsenweg 9

| | | | |
|------------------------|-----------------------------------------|----------------------|-------------------|
| Commission | Impulse Pumps B.V. | | |
| Project description | Controlbox for Oriental Diesel Electric | | |
| Type number | 11.05 | | |
| Manufacturer (company) | Impulse | | |
| Created on | 4-9-2018 | | |
| Edit date | 25-7-2023 | by (short name) diel | Number of pages 7 |


| | | | | | | | | | |
|--------------|------|------|----------|-----------|-----------------------------------------|-------------|----------------------|-------|------------|
| | | | Date | 23-4-2021 | Impulse Pumps B.V. | Impulse | Titelblad / voorblad | = | |
| | | | Ed | joris | | | | + | |
| | | | Appr | | Controlbox for Oriental Diesel Electric | | | | |
| Modification | Date | Name | Original | | Replacement of | Replaced by | | | Page 0 |
| | | | | | | | | 11.05 | Page 1 / 7 |

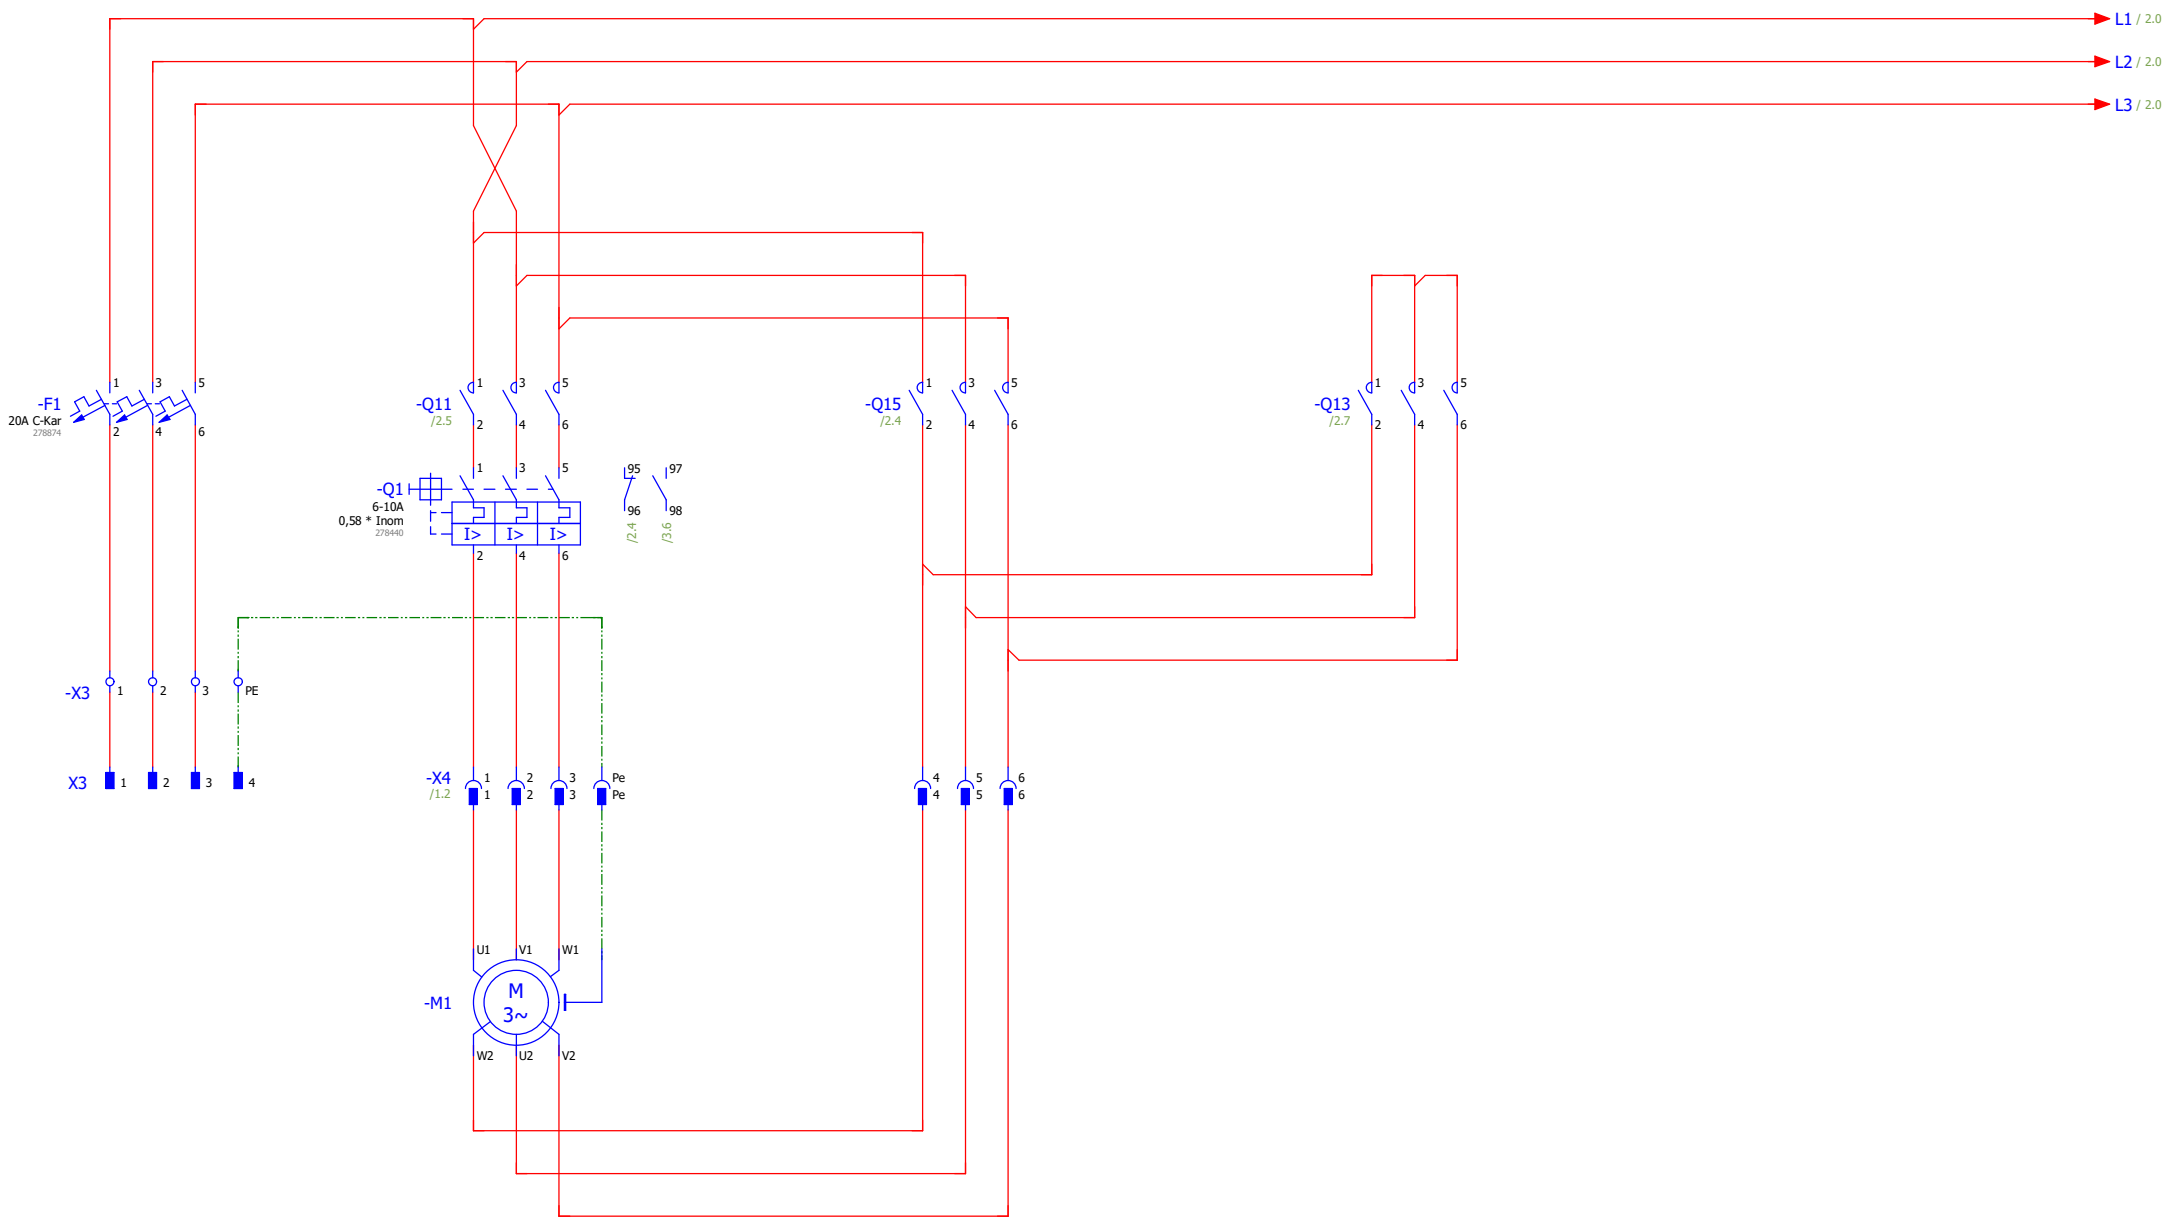


| | | | | | | | | | | | |
|--------------|------|------|----------|------|-----------|-----------------------------------------|---------|-------------|-------|------|-------|
| | | | | Date | 17-5-2021 | Impulse Pumps B.V. | Impulse | Hoofdstroom | | | = |
| | | | | Ed | joris | Controlbox for Oriental Diesel Electric | | | | | + |
| | | | | Appr | | Replacement of | | | 11.05 | Page | 1 |
| Modification | Date | Name | Original | | | Replaced by | | | | Page | 2 / 7 |

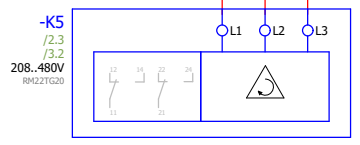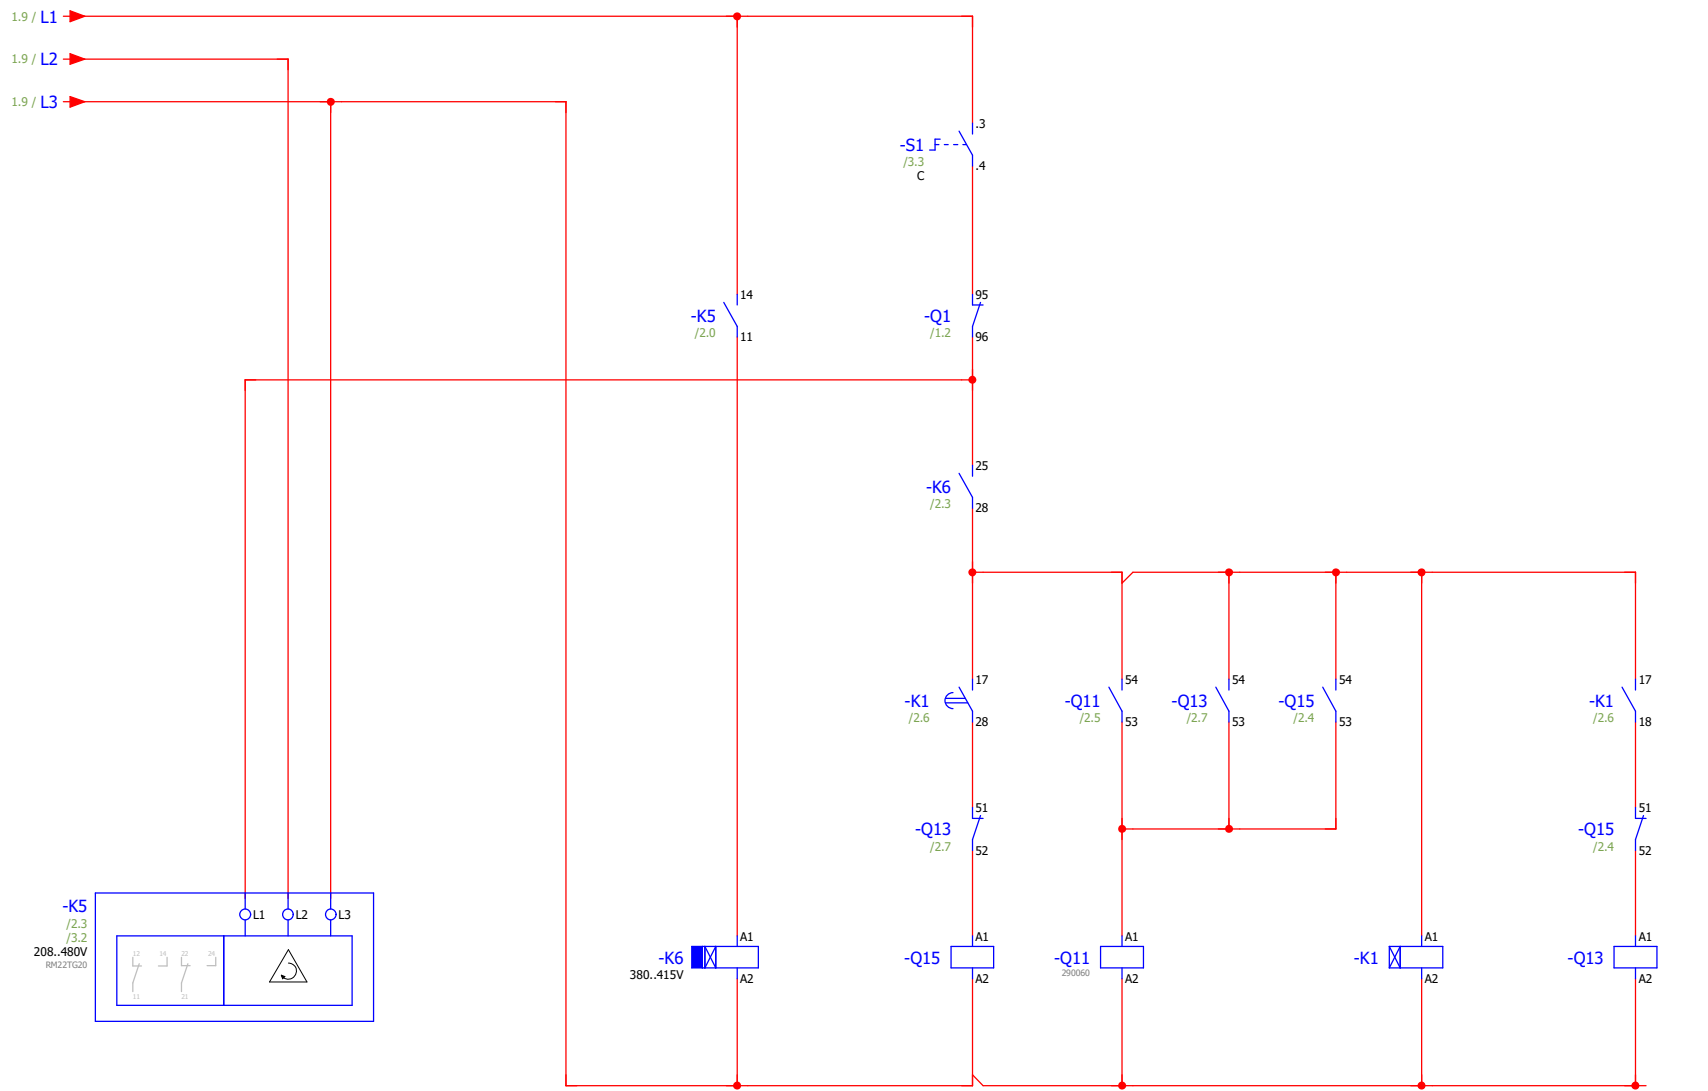


Total timer startcycle 5 sec delayed



Delta relay




S/D Timer



Star relay

| | | | | | | | | | | | | | | |
|--------------|--|--|--|------|-----------|-----------------------------------------|--|-------------|--|------------------|--|-------|--|-------|
| | | | | Date | 17-5-2021 | Impulse Pumps B.V. | | Impulse | | Stuurstroom 400V | | | | = |
| | | | | Ed | joris | Controlbox for Oriental Diesel Electric | | | | | | | | + |
| | | | | Appr | | Replacement of | | Replaced by | | | | 11.05 | | Page |
| Modification | | | | Date | Name | Original | | | | | | | | 3 / 7 |

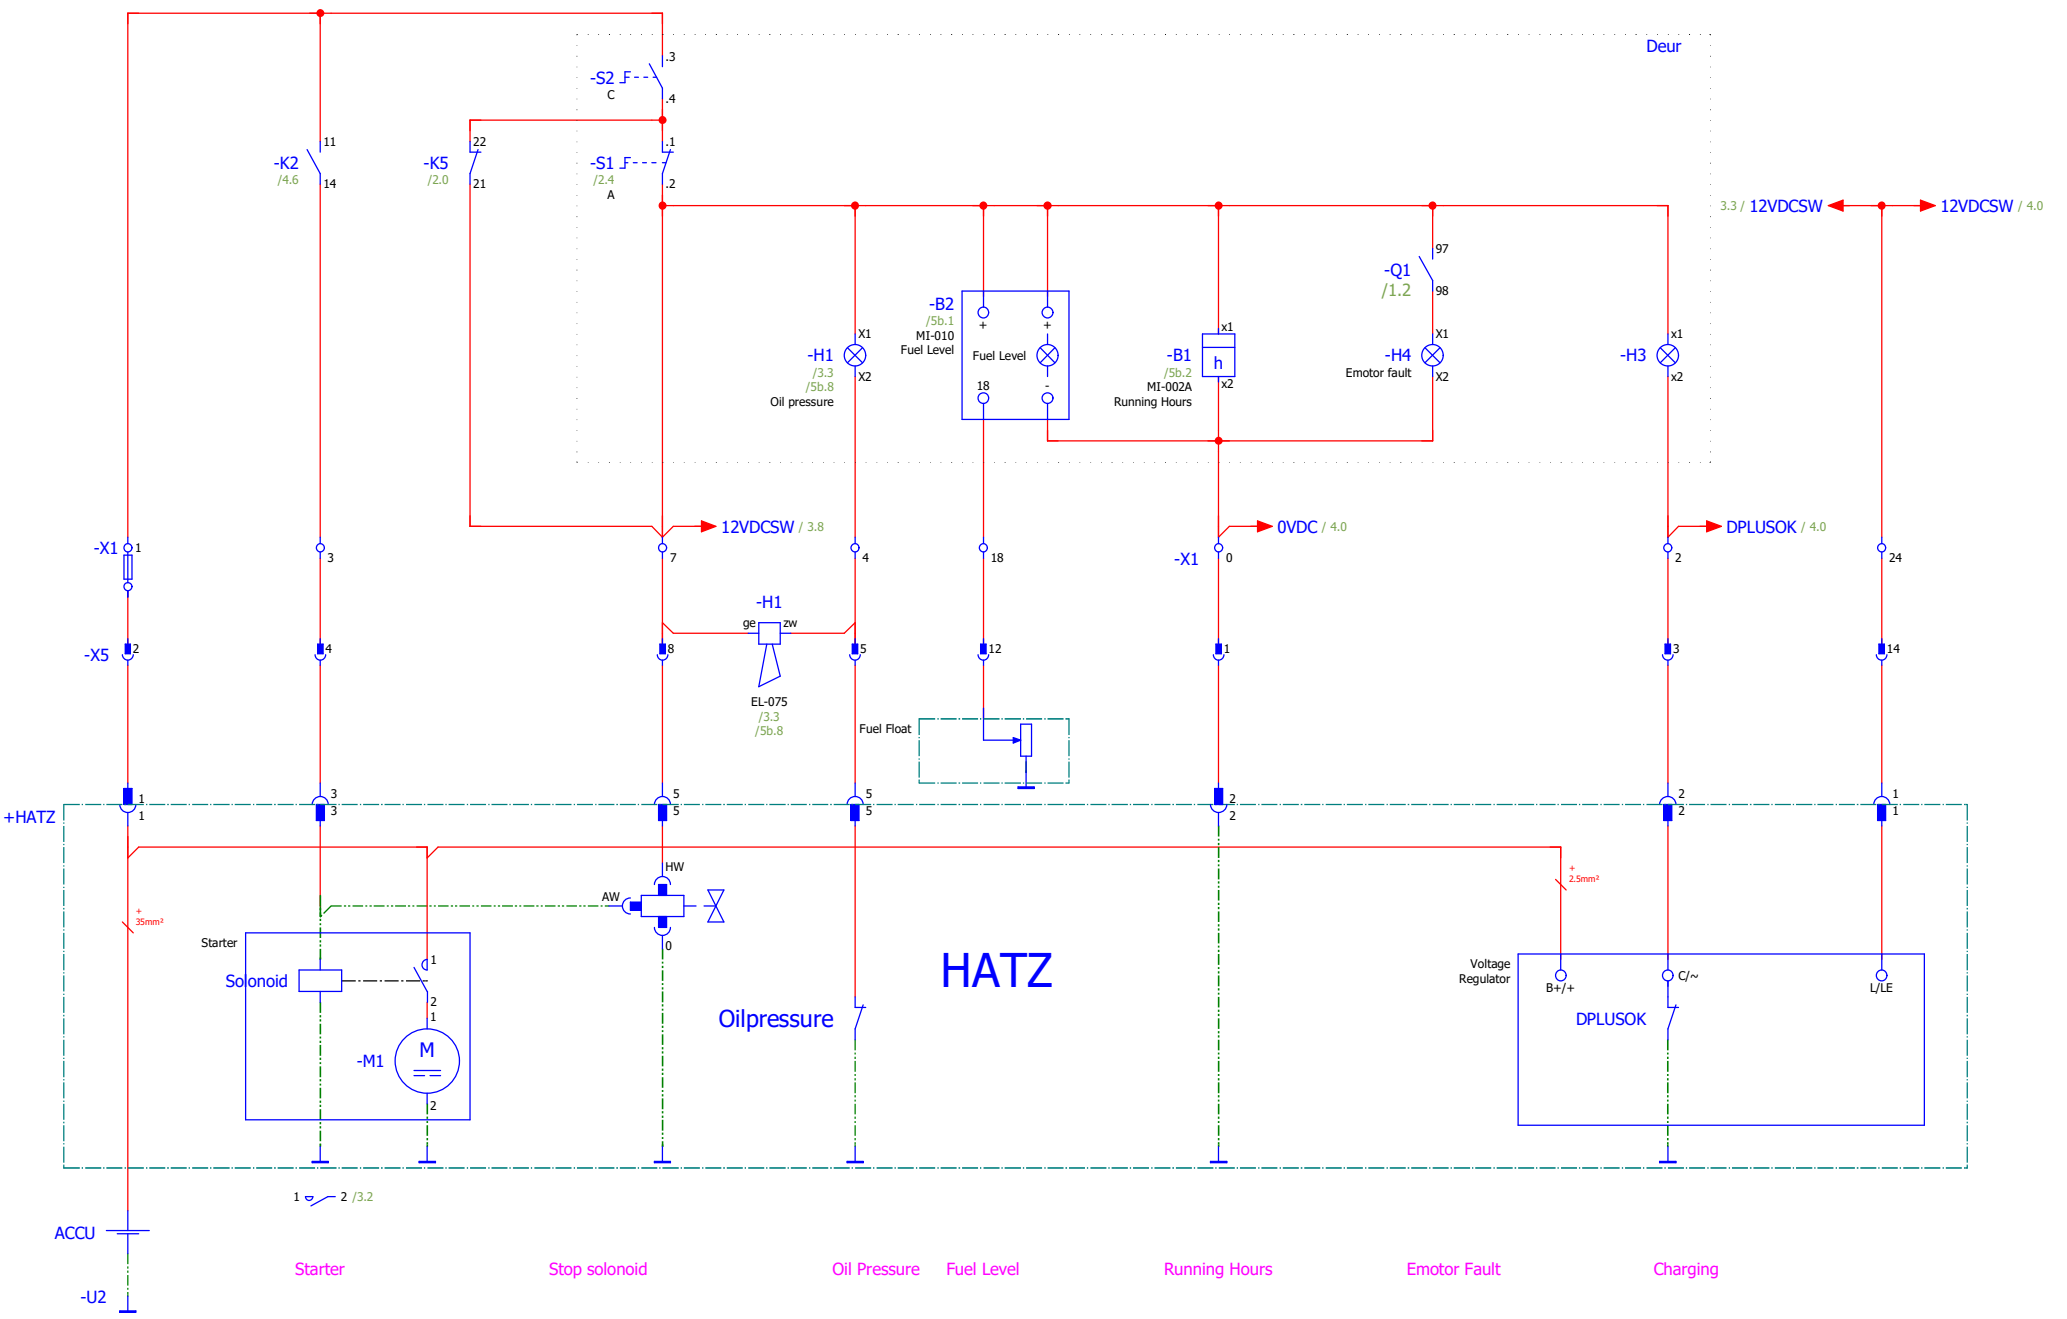

Starter

Stop solenoid

Oil Pressure


Fuel Level

Running Hours

Emotor Fault

Charging




| | | | | | | | | | | | | | |
|--------------|------|------|----------|------|-----------|-----------------------------------------|--|-------------|--|---------------|--|-------|------------|
| | | | | Date | 23-4-2021 | Impulse Pumps B.V. | | Impulse | | Stuurroom 12V | | | |
| | | | | Ed | joris | Controlbox for Oriental Diesel Electric | | | | | | | |
| | | | | Appr | | Replacement of | | Replaced by | | | | | |
| Modification | Date | Name | Original | | | | | | | | | 11.05 | Page 4 / 7 |

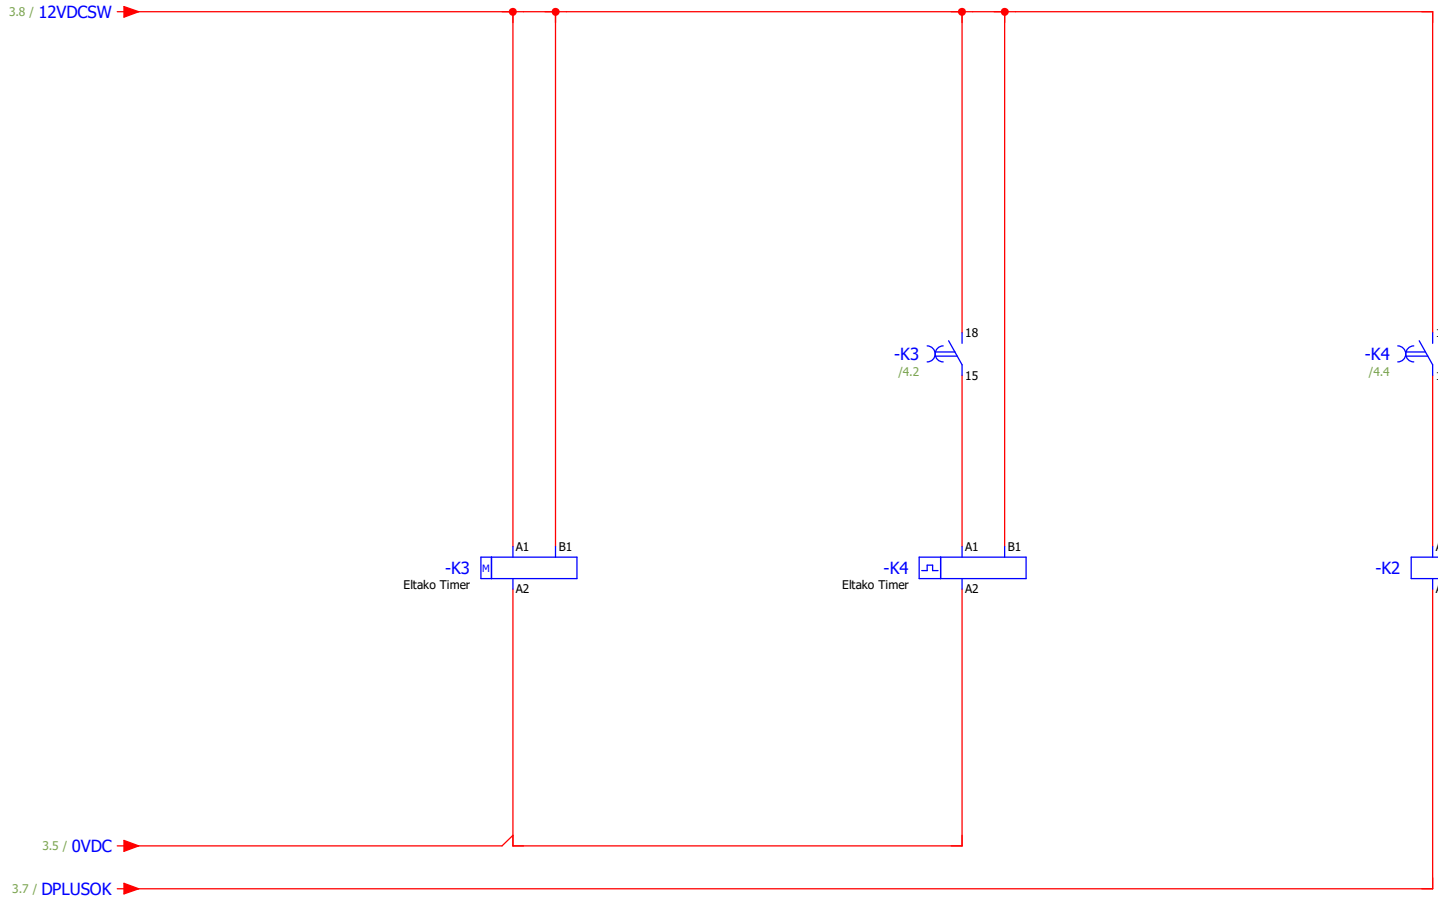

Total timer
startcycle
IF 45S

Startcycle
TP 10S - 5S

Start engine



| | | | | | | | | | |
|--------------|------|------|----------|-----------|-----------------------------------------|-------------|-----------------|-------|------------|
| | | | Date | 23-4-2021 | Impulse Pumps B.V. | Impulse | Stuurstroom 12V | = | |
| | | | Ed | joris | Controlbox for Oriental Diesel Electric | | | + | |
| Modification | Date | Name | Original | | Replacement of | Replaced by | | | Page 4 |
| | | | | | | | | 11.05 | Page 5 / 7 |

